


**CONCRETE PIPE BEDDING
TYPE I - CONCRETE CRADLE**

LOAD FACTOR 2.8

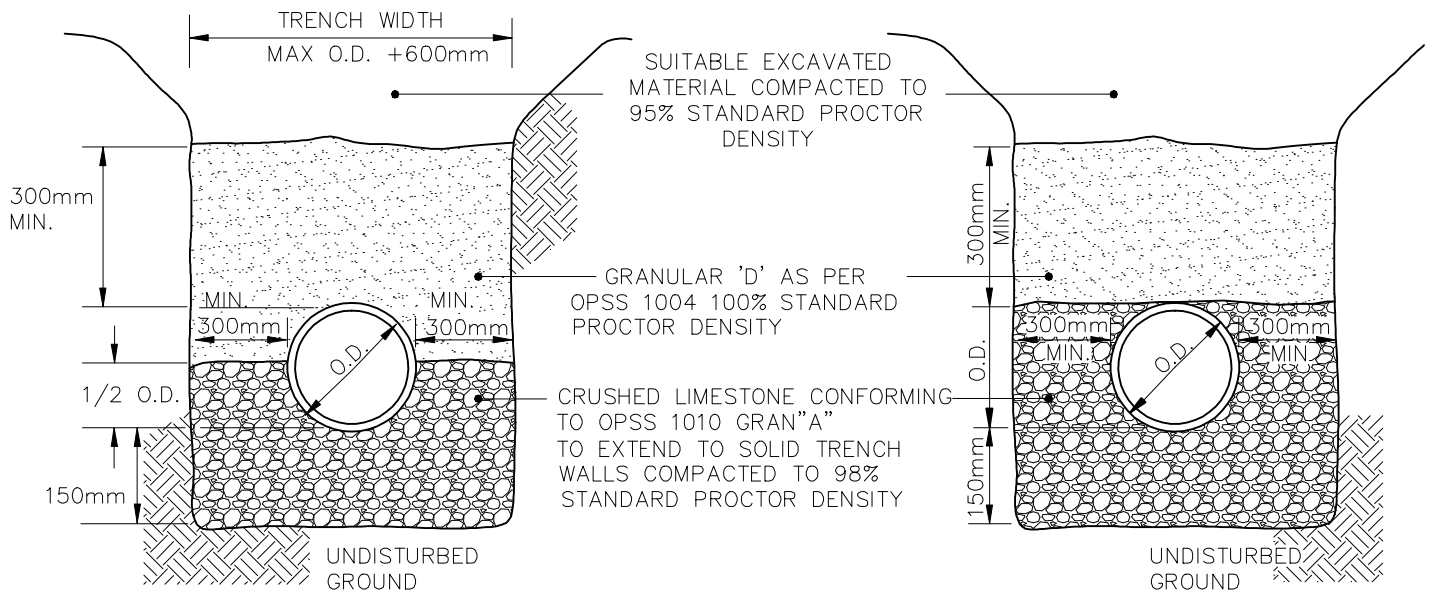

**CONCRETE PIPE BEDDING
TYPE II - CRUSHED STONE**

LOAD FACTOR 1.9

**PVC PIPE BEDDING
TYPE III - CRUSHED STONE**

NOTE:

1. COMPACTION TESTING TO BE DONE IN ACCORDANCE WITH TOWN OF AJAX MINIMUM TESTING REQUIREMENTS.
2. WET TRENCH CONDITION REQUIRES DETAIL FROM THE GEOTECHNICAL ENGINEER.