



WHERE A CURB RAMP IS PROVIDED AT A PEDESTRIAN CROSSING A TACTILE WALKING SURFACE MUST BE PROVIDED WITH RAISED TACTILE PROFILES AND HIGH TONAL CONTRAST WITH ADJACENT SURFACES

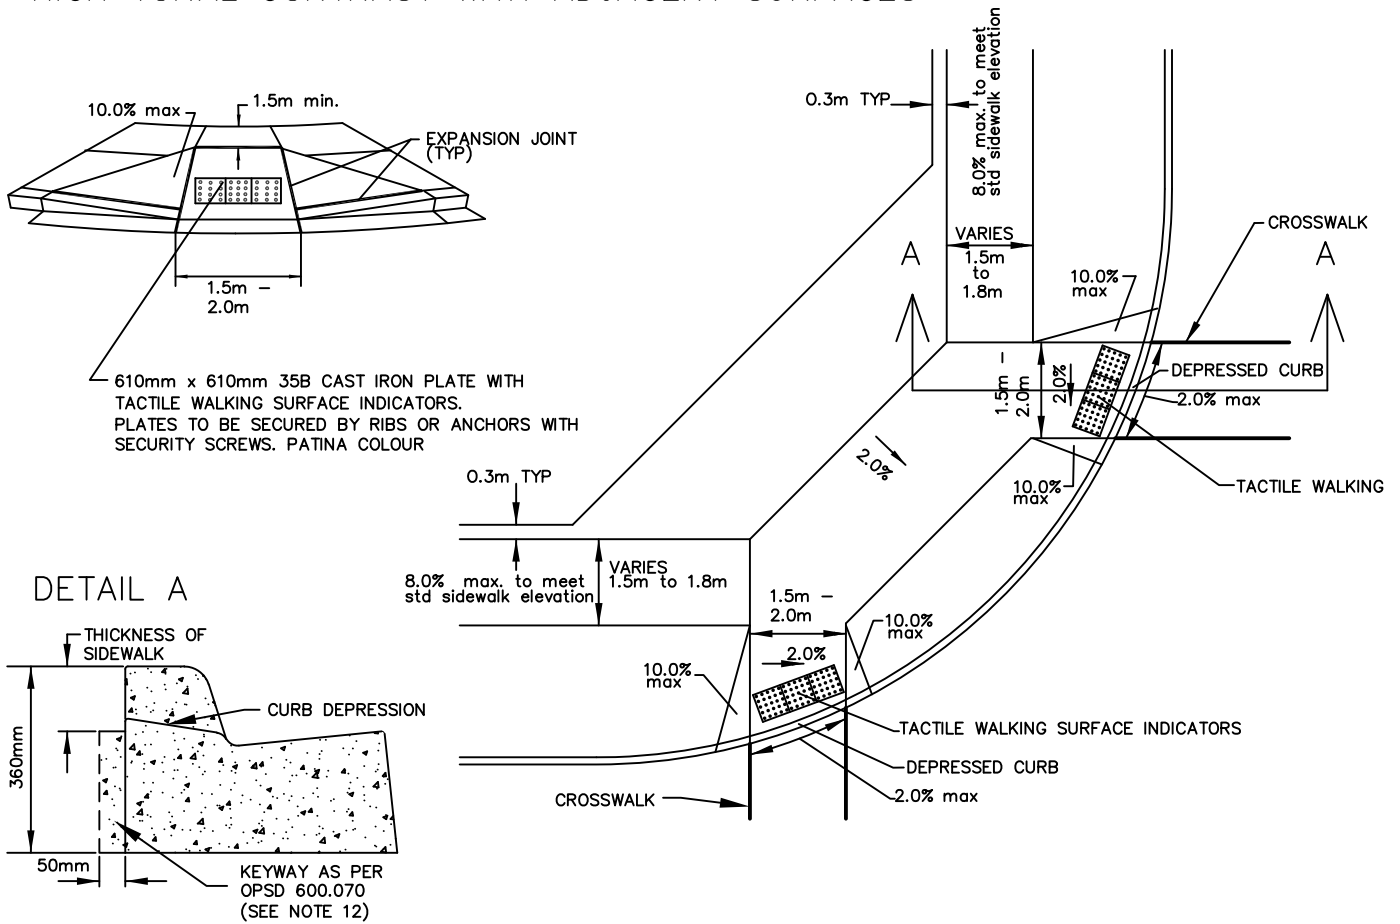


SECTION A-A

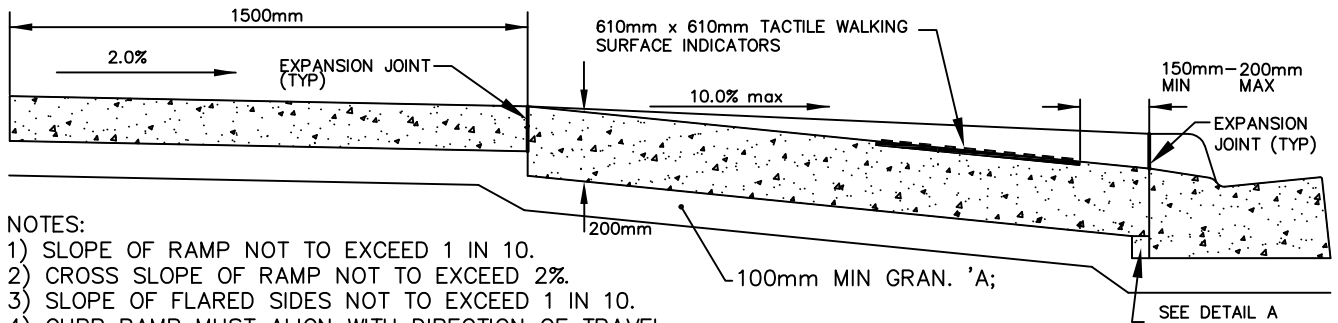

NOTES:

- 1) SLOPE OF RAMP NOT TO EXCEED 1 IN 10.
- 2) CROSS SLOPE OF RAMP NOT TO EXCEED 2%.
- 3) SLOPE OF FLARED SIDES NOT TO EXCEED 1 IN 10.
- 4) CURB RAMP MUST ALIGN WITH DIRECTION OF TRAVEL.
- 5) DROPPED CURB AT RAMP SHALL BE MODIFIED TO ELIMINATE 30MM STEP AT GUTTER.
- 6) MINIMUM THICKNESS OF RAMP IS 200mm.
- 7) MINIMUM THICKNESS OF SIDEWALK AND FLARED SIDES IS 130mm.
- 8) WHERE ONLY ONE CROSSWALK IS PRESENT AT AN INTERSECTION, ONLY ONE CURB RAMP IS REQUIRED.
- 9) TACTILE WALKING SURFACE TO BE SET BACK 150mm TO 200mm FROM CURB AND EXTEND THE FULL WIDTH OF THE CURB RAMP.
- 10) NO CUTS TO TACTILE PLATES ARE PERMITTED.
- 11) RADIUS PLATES MUST BE USED TO COMPLY WITH NOTE 9.
- 12) KEYWAY REQUIRED ALONG BACK OF CURB WHEN SIDEWALK IS ADJACENT TO CURB AS PER OPSD 600.070.



ENGINEERING SECTION

CONCRETE SIDEWALK AT INTERSECTIONS

DWG. No.

AS-234

DATE

MARCH 2017

REVISION No.

2